





PWBA PTQ ARLINGTON, TX

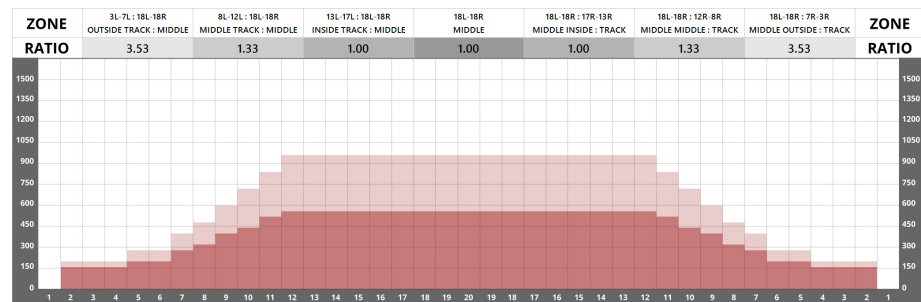

DISTANCE:	40 FEET	VOLUME:	24.72 mL
RATIO:	3.53:1	FORWARD:	15.2 mL
DROP BRUSH:	37 FEET	REVERSE:	9.52 mL
TANKS:	FIRE & ICE	PUMP:	40 μ L

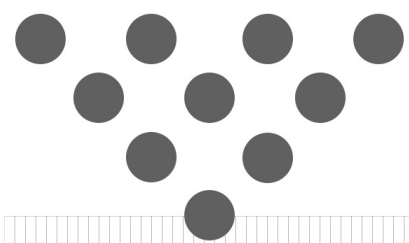


FORWARD LOADS DATA

#	START	STOP	LOADS	MICS	SPEED	BUFF	TANK	DISTANCE	T.OIL
1	2L	2R	4	40	14	3	A - FIRE	0 $\rightarrow$ 6	5,920
2	5L	5R	1	40	14	3	A - FIRE	6 $\rightarrow$ 8	1,240
3	7L	7R	2	40	14	3	A - FIRE	8 $\rightarrow$ 12	2,160
4	8L	8R	1	40	18	3	A - FIRE	12 $\rightarrow$ 14	1,000
5	9L	9R	2	40	18	3	B - ICE	14 $\rightarrow$ 19	1,840
6	10L	10R	1	40	18	3	B - ICE	19 $\rightarrow$ 22	840
7	11L	11R	2	40	18	3	B - ICE	22 $\rightarrow$ 27	1,520
8	12L	12R	1	40	18	3	B - ICE	27 $\rightarrow$ 29	680
9	2L	2R	0	40	22	3	B - ICE	29 $\rightarrow$ 37	0
10	2L	2R	0	40	26	3	B - ICE	37 $\rightarrow$ 40	0

REVERSE LOADS DATA

#	START	STOP	LOADS	MICS	SPEED	BUFF	TANK	DISTANCE	T.OIL
1	2L	2R	0	40	30	3	B - ICE	37 $\rightarrow$ 28	0
2	12L	12R	2	40	18	3	B - ICE	28 $\rightarrow$ 23	1,360
3	11L	11R	1	40	18	3	B - ICE	23 $\rightarrow$ 20	760
4	10L	10R	2	40	14	3	B - ICE	20 $\rightarrow$ 17	1,680
5	9L	9R	1	40	14	3	B - ICE	17 $\rightarrow$ 15	920
6	8L	8R	1	40	14	3	A - FIRE	15 $\rightarrow$ 13	1,000
7	7L	7R	1	40	14	3	A - FIRE	13 $\rightarrow$ 11	1,080
8	5L	5R	1	40	14	3	A - FIRE	11 $\rightarrow$ 9	1,240
9	2L	2R	1	40	14	3	A - FIRE	9 $\rightarrow$ 7	1,480
10	2L	2R	0	40	14	3	A - FIRE	7 $\rightarrow$ 0	0

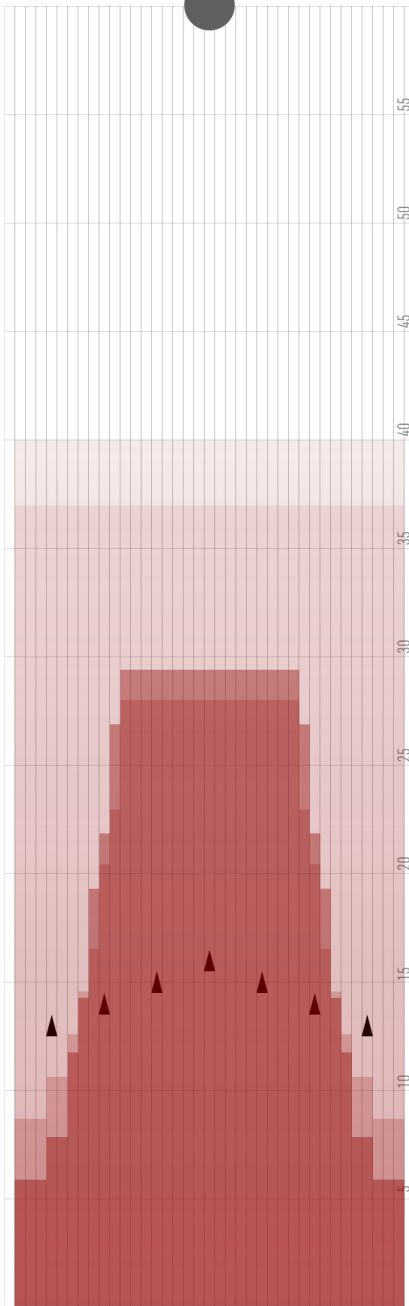

THIS PATTERN IS DESIGNED FOR:

DUAL CONDITIONING TANKS | REVERSE DROP BRUSH

This pattern may require adjustments if using a lane machine that does not have these features

SCAN QR CODE TO
SHARE AND
DOWNLOAD
THIS PATTERN



Created Jan 01, 2021